

**O<sub>2</sub> - CO<sub>2</sub>**

**automatic controller**

Control your Atmosphere,  
Maintain the high Quality  
of your products



**HortAir**  
Services  
*Atmosphere Management*

**Jason Anderson**  
Director  
027 2959623



# O<sub>2</sub> - CO<sub>2</sub> automatic controller

- **The automatic controller regulates the O<sub>2</sub> and CO<sub>2</sub> content and it also keeps track of the measurements taken during the storage period in the different rooms.**


The automatic controller can be used for up to 60 rooms.

The automatic controller includes :

- one programmable automate,
- one relay box with built-in analyzer,
- one control PC with modem,
- one UPS,
- one printer.

We will advise the most suitable option for your need.

Room	O <sub>2</sub> (%)	CO <sub>2</sub> (ppm)	Temp (°C)
10000	20.5	400	18.5
10001	20.5	400	18.5
10002	20.5	400	18.5
10003	20.5	400	18.5
10004	20.5	400	18.5
10005	20.5	400	18.5
10006	20.5	400	18.5
10007	20.5	400	18.5
10008	20.5	400	18.5
10009	20.5	400	18.5
10010	20.5	400	18.5
10011	20.5	400	18.5
10012	20.5	400	18.5
10013	20.5	400	18.5
10014	20.5	400	18.5
10015	20.5	400	18.5
10016	20.5	400	18.5
10017	20.5	400	18.5
10018	20.5	400	18.5
10019	20.5	400	18.5
10020	20.5	400	18.5
10021	20.5	400	18.5
10022	20.5	400	18.5
10023	20.5	400	18.5
10024	20.5	400	18.5
10025	20.5	400	18.5
10026	20.5	400	18.5
10027	20.5	400	18.5
10028	20.5	400	18.5
10029	20.5	400	18.5
10030	20.5	400	18.5
10031	20.5	400	18.5
10032	20.5	400	18.5
10033	20.5	400	18.5
10034	20.5	400	18.5
10035	20.5	400	18.5
10036	20.5	400	18.5
10037	20.5	400	18.5
10038	20.5	400	18.5
10039	20.5	400	18.5
10040	20.5	400	18.5
10041	20.5	400	18.5
10042	20.5	400	18.5
10043	20.5	400	18.5
10044	20.5	400	18.5
10045	20.5	400	18.5
10046	20.5	400	18.5
10047	20.5	400	18.5
10048	20.5	400	18.5
10049	20.5	400	18.5
10050	20.5	400	18.5

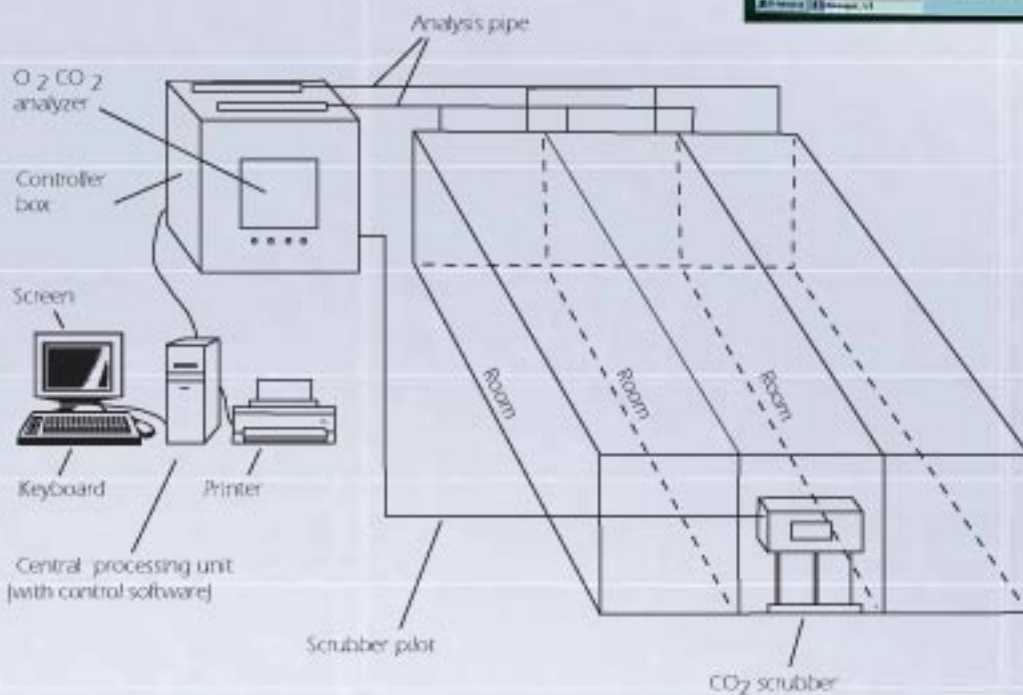

3d2d4c1c 05 63 23 21 31 - 02003 Documents and photographs are not contractual

